

## Analytical Report

Sample ID	2437 - Analysis Service - A1181
Expected	Estradiol Valerate
Sample adulterated or impure?	No
Sample Appearance	
Sample type	#N/A -
Date of sample receipt	20-Feb-2025
Date of analysis	21-Feb-2025
Date of Report	22-Feb-2025

### Qualitative and Quantitative Results

#### Substances identified

	Harm Reduction information	Chemical Class	Pubchem ID	Analytical techniques used
Estradiol valerate 99.6%	<a href="https://psychonautwiki.org/wiki/Estradiol">https://psychonautwiki.org/wiki/Estradiol</a>	Hormone	5757	FTIR/LCMS/NMR

\* uncertainty of measurement +/- 5 %  
Unless stated otherwise elsewhere

***The Analysis Report is not a warranty or advertisement for the quality of any supplier or product!  
We do not claim nor make any guarantees or recommendations regarding the safety of the analysed samples for human consumption.***

*Kykeon Analytics Ltd. assumes no liability for the results or for any damages that may arise from the use of the Analysis Report. The Analysis Report is not to be used for defence purposes in any type of proceeding without the explicit consent of KYKEON, its contents shall not be disclosed to any third party for marketing purposes. The Analysis Report shall not be altered, modified, amended, falsified, forged or changed in any way.*



Detailed information regarding our workflow including a full description of the analytical methods applied is freely available under <https://www.kykeonanalytics.com/services/users/>


Attachments:




**KYKEON**  
ANALYTICS

#2437 - Estradiol valerate 99.6%  
Internal standard: TMB

2025-02-21T18:15:31+0100  
NMReady 100/nanalysis-oc162  
DMSO-d6  
SF: 102.19  
T: 33.3 °C  
NS:32  
d1: 56.0331  
RG: 28.0

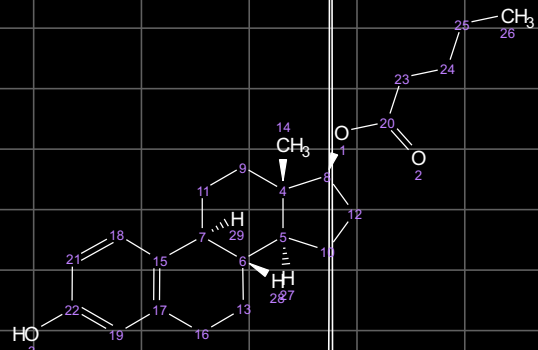

4.73  
4.65  
4.58  
3.74  
3.31 H<sub>2</sub>O  
2.74  
2.57 DMSO-d6  
2.55 DMSO-d6  
2.53 DMSO-d6  
2.51 DMSO-d6  
2.49 DMSO-d6  
2.39  
2.38  
2.32  
2.25  
2.19  
2.09  
1.83  
1.74  
1.64  
1.61  
1.56  
1.54  
1.50  
1.47  
1.43  
1.39  
1.37  
1.35  
1.34  
1.31  
1.29  
1.22  
1.16  
0.98  
0.97  
0.91  
0.89  
0.85  
0.83  
0.81

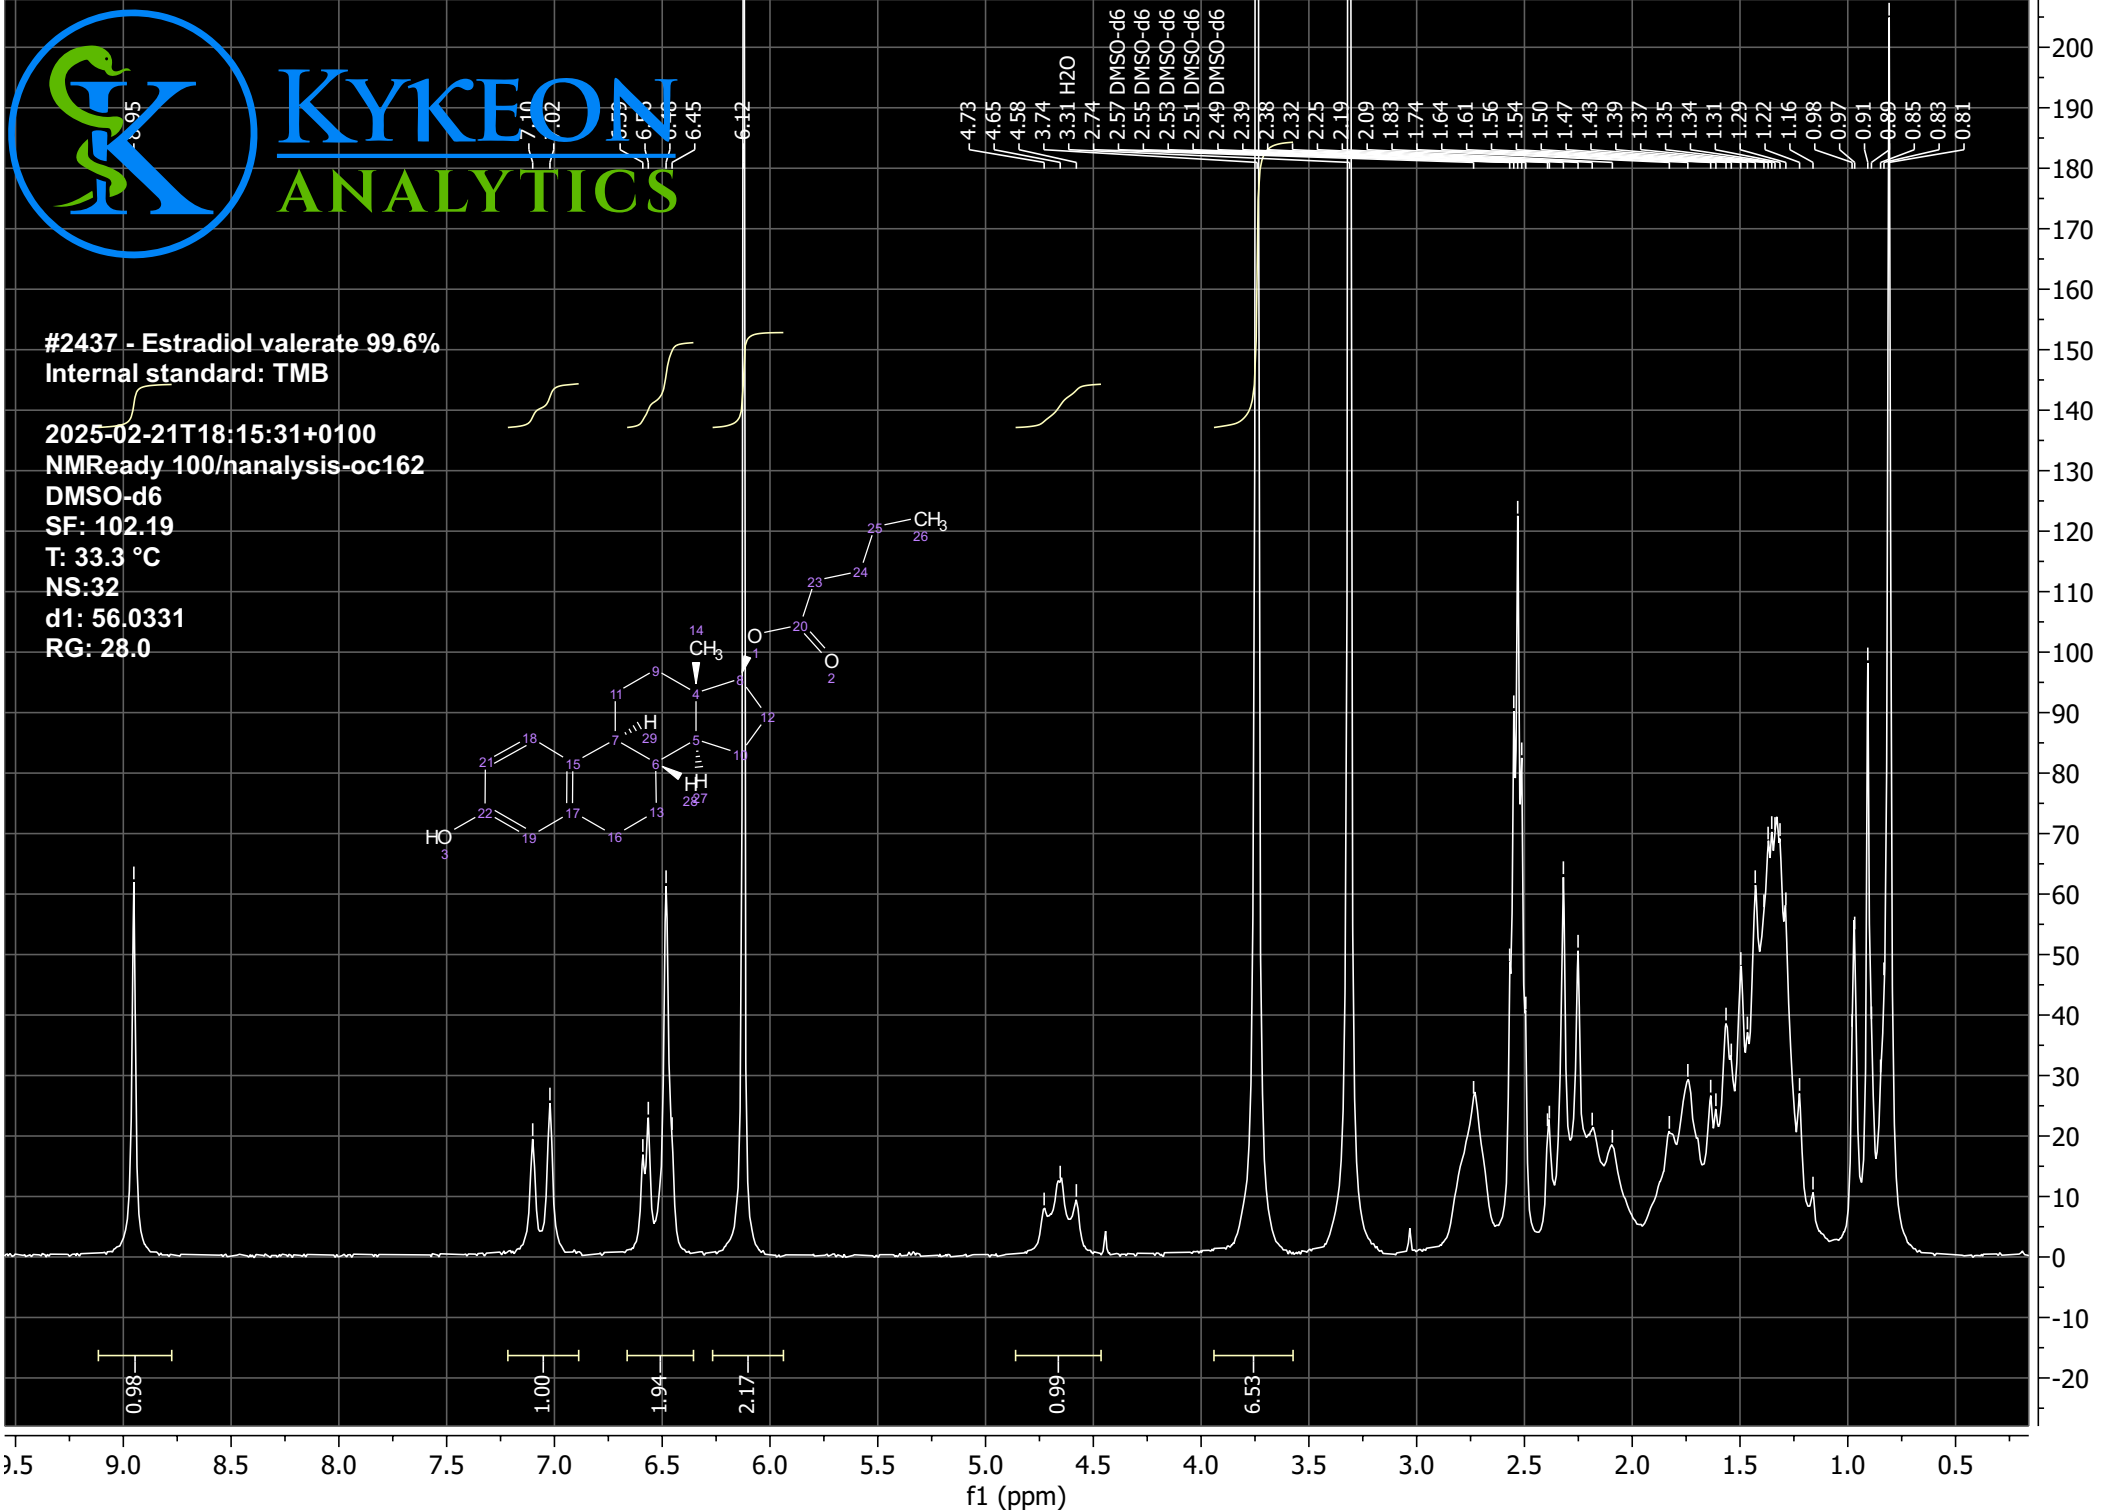

0.98

1.00

1.94

2.17

0.99

6.53

9.5 9.0 8.5 8.0 7.5 7.0 6.5 6.0 5.5 5.0 4.5 4.0 3.5 3.0 2.5 2.0 1.5 1.0 0.5

f1 (ppm)